



10 TYPICAL DUCT LINE TERMINATION FOR FUTURE EXPANSION NOT SCALE


NOTE: ALL STUDENTS FROM MANHOLE SHALL HAVE A MINIMUM OF 36\"/>

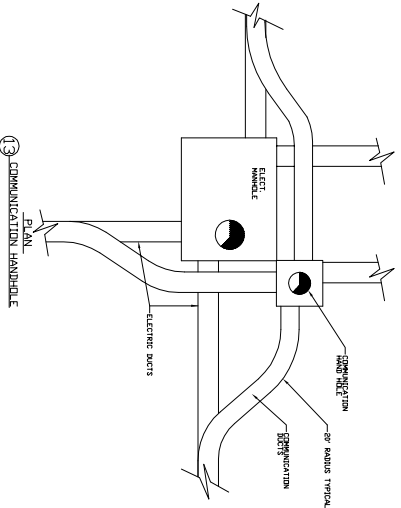


11 COMMUNICATION HANDLE




9 HOOK TO REINFORCING BAR OF HANDLE SCALE: NTS




6 LADDER SCALE: NTS




6 WALL OF HANDLE

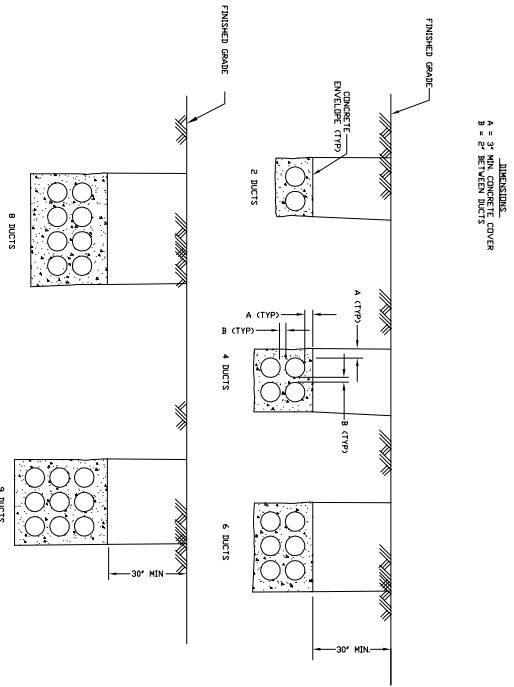

11 5\"/>

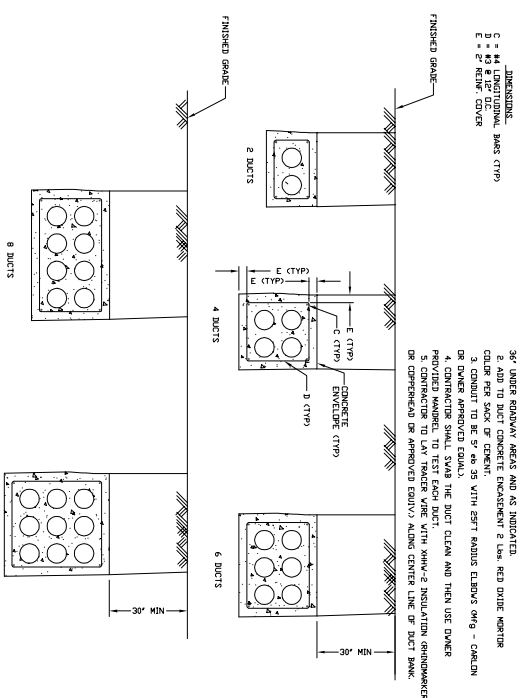

12 5\"/>



7 PREFABRICATED CONCRETE SPACER BLOCKS SCALE: NTS

UNIVERSITY OF NORTHERN IOWA
 ENGINEERING SERVICES
 CENTRAL FALLS, IOWA 50601-0197
 (319) 273-2811 FAX 273-6973
 Duct-5-91
 Scale: NOT TO SCALE
 Date: December 2011
 Page: 1 of 1